


Notes:

1. Paint portion of Service Marker that is above grade with white paint. Stencil "S/S" with 3" tall black letters.
2. For 8" mains or larger, provide 6" tee. For 6" pipe, provide 6" wye.
3. Provide detector tape over bedding for entire length of stub.
4. Maximum stub length shall be 100'.
5. For developer extension projects, extend stub 5' to 10' into property. Otherwise terminate stub at property line or edge of easement.

2"x4" Service Marker, length as required. See note 1.

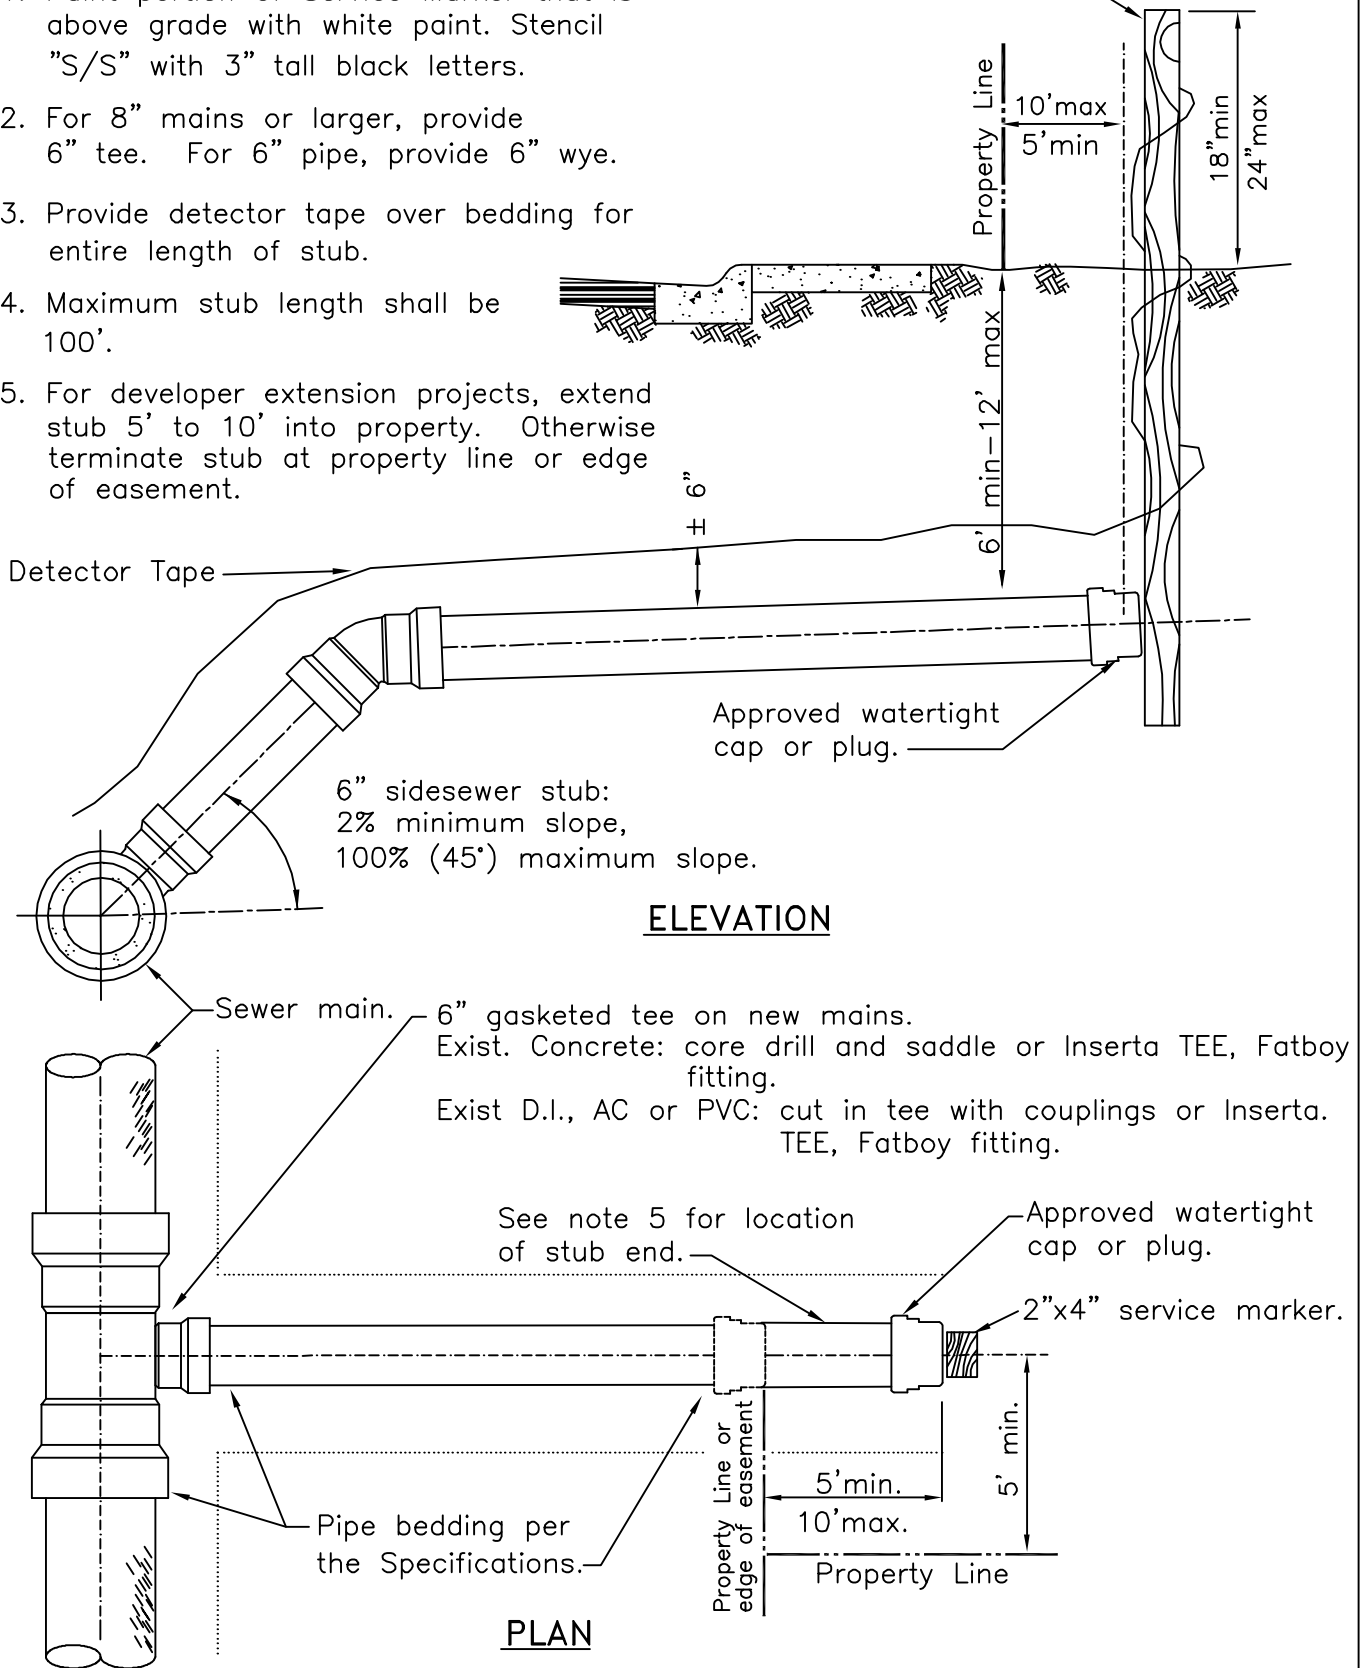

SIDE SEWER STUB

NOT TO SCALE

Detail Approvals
 Engineer GSM
 Manager DPK

**NORTHSHORE UTILITY DISTRICT
 STANDARD SEWER DETAILS**

7