


WYE CLEANOUT AT EDGE OF R.O.W. OR EASEMENT

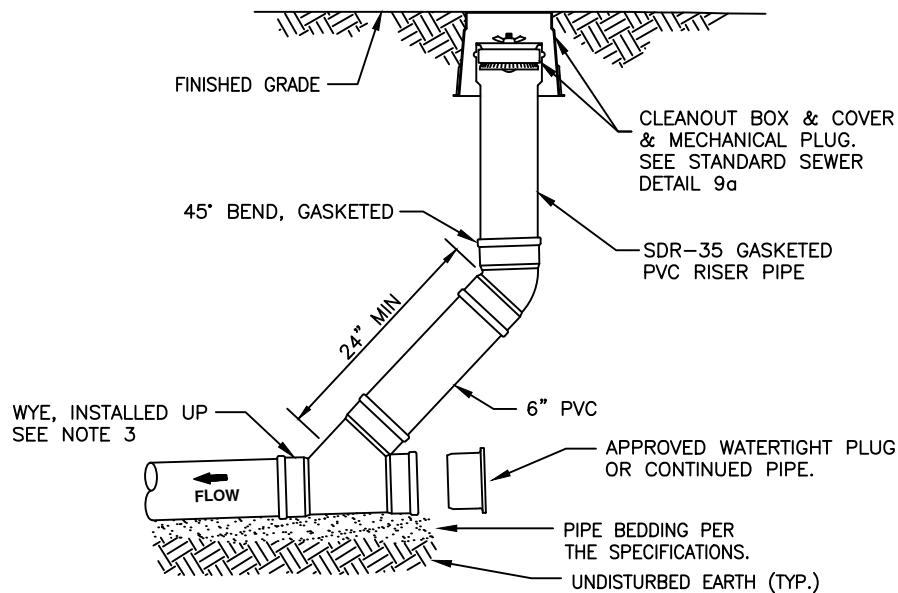

NOTES:

WYE CLEANOUT ON PROPERTY

1. ALL CLEANOUTS SHALL BE BROUGHT TO THE SURFACE. CLEANOUTS ARE REQUIRED AT THE EDGE OF R.O.W. OR EASEMENT, AT THE BUILDING, AND EVERY 100 FEET.
2. CLEANOUTS LOCATED IN HARDSCAPE AND AT THE EDGE OF R.O.W. OR EASEMENT REQUIRE A CAST IRON CLEANOUT BOX PER STANDARD SEWER DETAIL 9a.
3. THE SIDE SEWER CONNECTION AT THE MAIN LINE STUB SHALL BE PER STANDARD SEWER DETAILS 7 & 8a. PIPE SIZE SHALL REMAIN 6" UNTIL UPSTREAM OF THE WYE CLEANOUT AT EDGE OF R.O.W. OR EASEMENT.
4. RISER PIPE SHALL BE PERPENDICULAR TO CLEANOUT BOX COVER AND CENTERED WITHIN CLEANOUT BOX. RISER PIPE FOR CLEANOUTS AT EDGE OF R.O.W. OR EASEMENT SHALL MATCH THE SIZE OF THE DISTRICT OWNED STUB. RISER PIPE FOR CLEANOUTS WITHIN PROPERTY ARE TO BE MINIMUM 4".
5. ALL PIPE MATERIAL SHALL BE BELL & SPIGOT TYPE WITH RUBBER GASKET JOINT AND SHALL BE IN CONFORMANCE WITH ASTM D3034 (SDR-35).

SIDE SEWER SURFACE CLEANOUT

NOT TO SCALE

DETAIL APPROVALS

EDITOR TMC

ENG. DIR. CF

NORTHSHORE UTILITY DISTRICT

2025 STANDARD SEWER DETAILS

9

LAST UPDATED
MAY 2025